

**TOWN OF JAMESTOWN  
TOWN COUNCIL MEETING  
for  
TOWN, WATER AND SEWER MATTERS**

A regular meeting of the Jamestown Town Council sitting as the Board of Water and Sewer Commissioners was held on July 19, 2021. This meeting was held pursuant to Executive Order No. 20-05, executed by Governor Gina Raimondo and was teleconferenced via Zoom.

The meeting was called to order via Zoom at 6:33 PM by Commission President Nancy A. Beye. The following members were present:

Mary E. Meagher, Commission Vice-President  
Erik G. Brine  
Michael G. White  
Randall White

Also, present were:

Jamie A. Hainsworth, Town Administrator  
Denise Gamon, Town Clerk's Assistant  
Christina D. Collins, Finance Director  
Michael Gray PE, Public Works Director  
Lisa Bryer, Town Planner  
Peter D. Ruggiero Esq., Town Solicitor  
Denise Jennings, Water and Sewer Clerk

**AWARDS, PRESENTATIONS AND ACKNOWLEDGMENTS**

(None)

**READING AND APPROVAL OF MINUTES**

1) June 21, 2021 (regular meeting)

Motion was made by Commission President Meagher, seconded by Commissioner Brine to accept the June 21, 2021 regular meeting minutes. Vote: President Beye, Aye; Commission Vice-President Meagher, Aye; Commissioner Brine, Aye; Commissioner Michael White, Aye; Commissioner Randall White, Aye

**OPEN FORUM**

Commission President Beye noted that this open forum would be for water and sewer matters only.

1) Scheduled requests to address:

(None)

2) Non-scheduled request to address:

(None)

## REPORT OF TOWN OFFICIALS

### 1) **Pumping Report:**

The Public Works Director reported the following:

- JR-1 is currently in service.
- Pumping was up for the month of June, compared to May 2021 and was down slightly compared to June of 2020.
- Rainfall is up slightly for the month of June, although we have had a significant amount of rain in July and we should be okay through the end of the year.
- North Reservoir is @ 60MG, usable storage-60MG.
- South Pond is @ 6MG, usable storage- 6MG

### 2) **Town project reports:** *(See attached Project Update Report dated July 2021)*

Following a brief report by the Public Works Director, it was the consensus of the Commission, to accept the Public Works Director's report, as submitted.

## LETTERS AND COMMUNICATIONS

(None)

## UNFINISHED BUSINESS

(None)

## NEW BUSINESS

### 1) Review, Discussion and/or Action and/or Vote on the application of **Our Table, LLC/Marla Romash (applicant) and Gino DiFante (owner) of 53 Narragansett Avenue, Plat 9, Lot 207 (a portion of the first floor), for Utility Service Expansion/Change of Use.**

Commission President Beye stated that the applicant does not appear to be present at the meeting.

Commissioner Randall White stated that since the applicant is not present and also since their application is pending review by the Planning Commission that it would be premature for this Board to review the application. Commissioner Randall White suggested that the application be continued until the Planning Commission has completed their review.

The Town Planner briefly outlined a few of the pending matters, before the Planning Commission.

Motion was made by Commissioner Randall White, seconded by Commissioner Meagher to continue the application of Our Table , LLC/Marla Romash (applicant) and Gino DiFante (owner) of 53 Narragansett Avenue, Plat 9, Lot 207 (a portion of the first floor), for Utility Service Expansion/Change of Use until the Planning Commission has completed their review. Vote: President Beye, Aye; Commission Vice-President Meagher, Aye; Commissioner Brine, Aye; Commissioner Michael White, Aye; Commissioner Randall White, Aye

**ADJOURNMENT**

Motion was made by Commissioner Michael White, seconded by Commissioner Brine to adjourn the meeting of the Jamestown Town Council sitting as the Board of Water and Sewer Commissioners at 6:50 PM. Vote: President Beye, Aye; Commission Vice-President Meagher, Aye; Commissioner Brine, Aye; Commissioner Michael White, Aye; Commissioner Randall White, Aye

Attest:

Denise Jennings  
Water and Sewer Clerk

## **Project Update July 2021**

### **WELLS**

JR-1, JR-3

- JR-1 is currently in service. The well pumps water at a rate of 50 gpm directly into the transmission main feeding the water plant from the reservoir.

### **TREATMENT PLANT**

- We received comments from RIDOH regarding the Corrosion Control Study that we are conducting with North Kingstown Water. They have requested that we collect samples on a bi-weekly basis for the study which we started this past month. Based upon samples collected over the past few months the analytical results indicate that the use of the North Kingstown water will have no impact to water quality in Jamestown. Sampling will continue into September and a full report will be submitted to RIDOH for their review and approval.
- We are preparing our 21/22 budget for the Commission to approve. A proposed budget will be submitted for review at our August meeting.

### **TRANSFER PUMPING/RESERVOIR**

- The north reservoir is at our maximum capacity and continues to spill over with the rainfall that we have received over the past two weeks.

### **DISTRIBUTION SYSTEM**

South Pond @ 6 MG

Usable Storage, 6 Million Gallons

North Pond @ 60 MG

Usable Storage 60 Million Gallons


- I met with engineers from Verizon onsite and will be having meetings with Sprint/T-Mobile, and AT&T regarding the existing antennae on the Tower. The antennae will need to be moved temporarily based on discussions with engineers from all three carriers. They will not be able to meet our schedule for a project in 2021. I will be working with our consultant to determine how we move forward with a project in 2022 and how the logistics of moving antennae can work with our project. This will have an impact with the cost of our project.

### **WASTEWATER TREATMENT PLANT**

- The monthly average daily flow at the treatment plant for June was 0.21 million gallons per day. The monthly average allowed by our discharge permit is 0.73 million gallons per day. The peak daily flow was 0.39 million gallons. There were no sanitary sewer overflows for the month of June.


# RESERVOIR LEVEL

	1993	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021
Jan		30	60	42	55	45	46	45	60	60	60	57
Feb		52	60	60	60	45	58	55	60	60	60	60
Mar		58	58	60	60	60	60	60	60	60	60	60
Apr		60	60	60	60	60	60	60	60	60	60	60
May		57	60	55	58	56	55	60	60	60	57	60
Jun		51	54	60	51	51	50	54	54	60	51	60
Jul		43	49	58	55	49	44	47	45	60	43	60
Aug	9	47	43	43	45	44	35	43	35	56	31	60
Sep	8	45	40	40	41	40	23.5	42	36	47	25	60
Oct	5	58	38	38	39	33	22	43	55	47	23	60
Nov	10	60	35	36	34	30	20	45	60	51	35	60
Dec		60	42	46	43	44	38	46	60	60	50	60

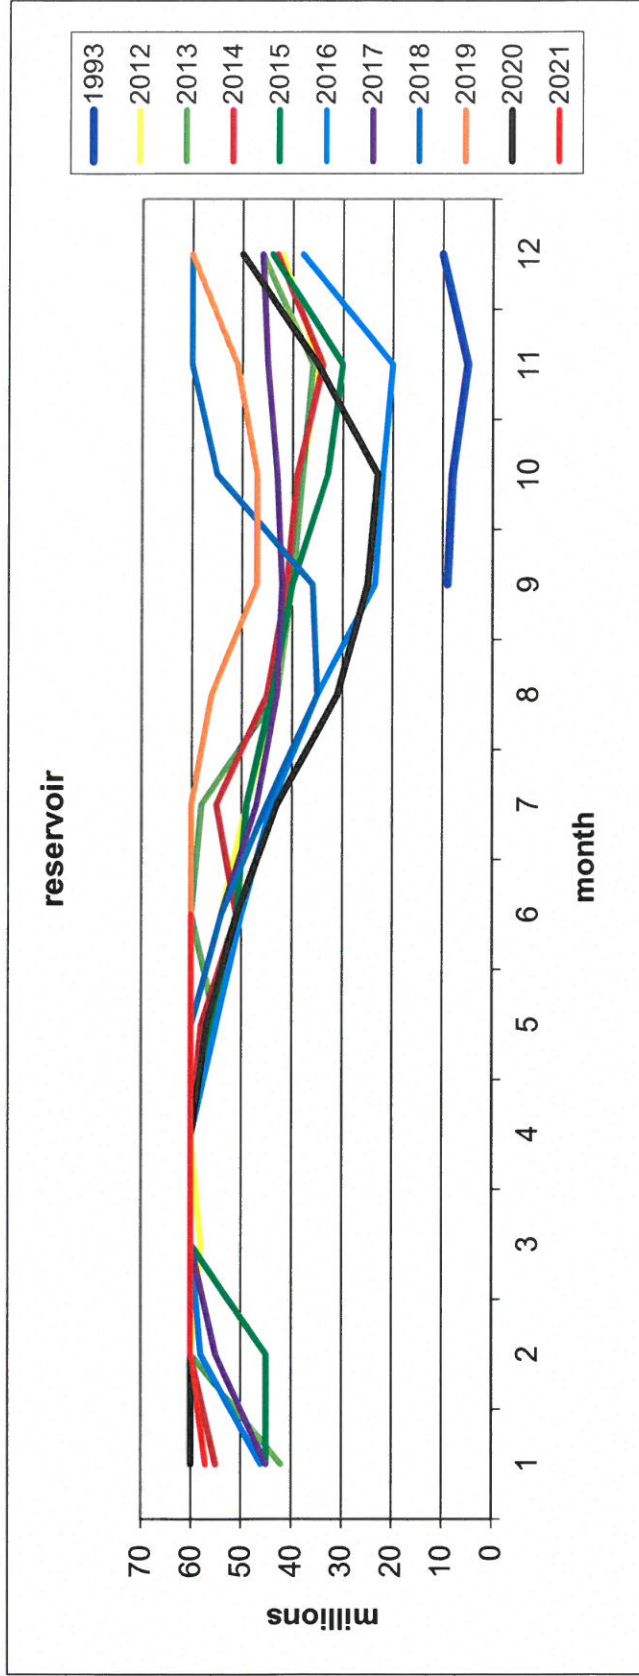


	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021
<b>AVG. RAINFALL</b>										
Jan	3.5	1.85	3.1	1.22	2.94	2.94	2.94	2.19	1.3	2.94
Feb	3.2	2.94	4.98	0.86	4.25	0.76	4.33	3.06	3.26	2.62
Mar	4.4	1.32	5.74	4.53	2.36	2.62	3.07	4.11	2.21	2.66
Apr	3.9	1.92	4.8	1.47	3.53	8.8	3.79	4.61	4.03	3.18
May	3.5	3.11	1.27	0.32	2.24	6.03	2.03	2.46	1.79	3.2
Jun	3.6	7.55	2.86	4.2	0.89	1.79	0.89	4.44	1.36	1.4
Jul	3.7	2.42	5.93	4.63	2.19	2.7	0.61	4.33	2.16	22.1
Aug	3.8	3.98	1.23	2.17	1.88	2.4	1.73	1.58	0.91	avg
Sep	3.7	2.13	0.5	3.41	2.42	1.54	8.35	1.49	1.27	
Oct	3	0.9	3.61	1.31	5.33	6.18	5.34	5.04	4.29	
Nov	4.6	3.76	1.47	2.27	2.63	2.61	9.61	1.89	3.39	
Dec	3.9	3.76	3.1	4.2	2.79	1.81	4.33	6.09	4.53	
<b>Total</b>	<b>44.8</b>	<b>35.64</b>	<b>38.59</b>	<b>30.59</b>	<b>33.45</b>	<b>40.18</b>	<b>47.02</b>	<b>41.29</b>	<b>30.5</b>	<b>16</b>

## RAINFALL

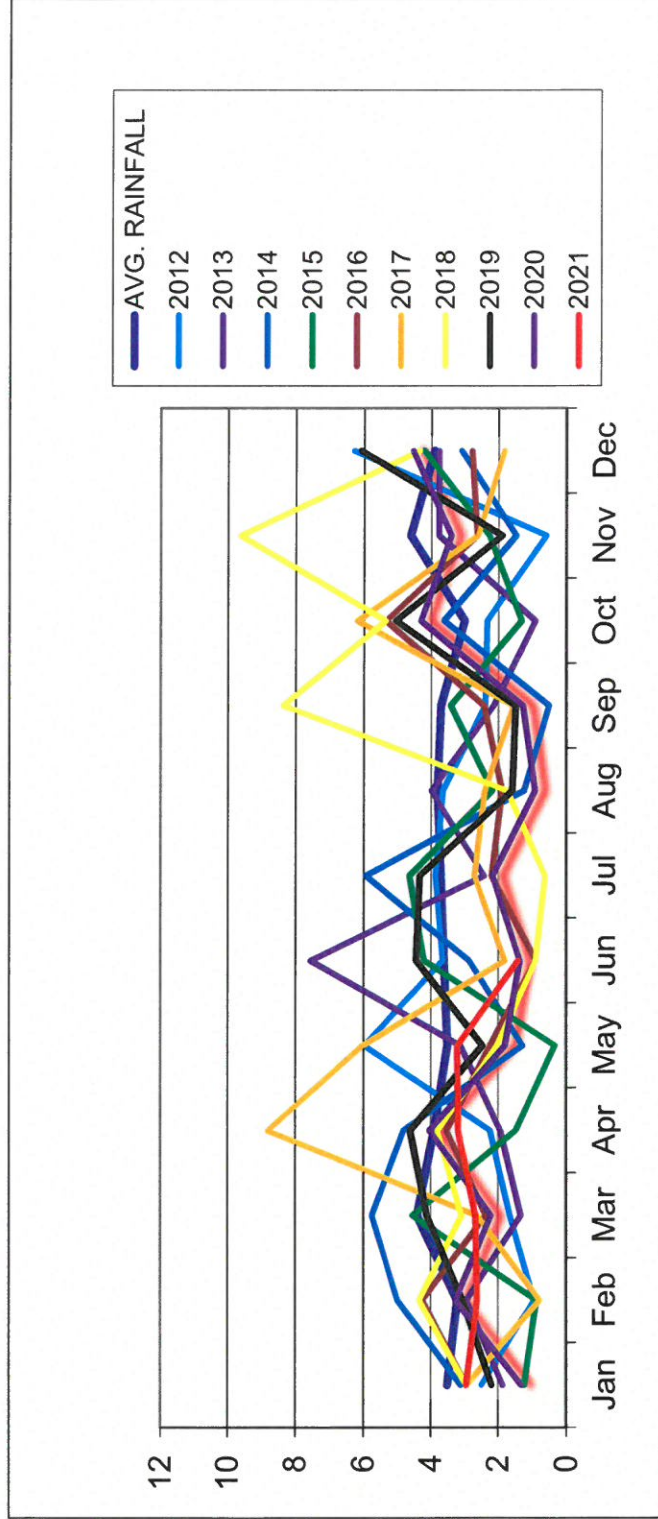

	1993	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021
Jan	171	172	173	239	172	155	191	163	165	159	149	165	141	141	144
Feb	192	154	173	210	158	156	187	151	165	165	155	137	135	129	151
Mar	169	155	165	198	157	155	178	147	154	160	156	139	144	166	158
Apr	181	174	196	210	180	170	198	184	160	190	183	167	167	163	160
May	227	202	195	180	212	190	223	185	239	202	183	184	179	200	201
Jun	285	246	215	218	226	221	226	232	230	240	210	227	204	242	230
Jul	311	296	277	274	279	278	291	267	264	288	261	288	261	279	
Aug	301	256	290	251	254	242	291	266	263	264	266	265	235	260	
Sep	188	210	245	193	205	210	212	227	215	201	203	208	189	241	
Oct	175	187	259	182	175	175	184	187	172	166	170	168	158	180	
Nov	166	175	226	160	164	167	177	160	160	157	151	148	146	149	
Dec	158	192	230	167	158	180	174	161	158	151	151	142	145	149	

### PUMPING REPORT

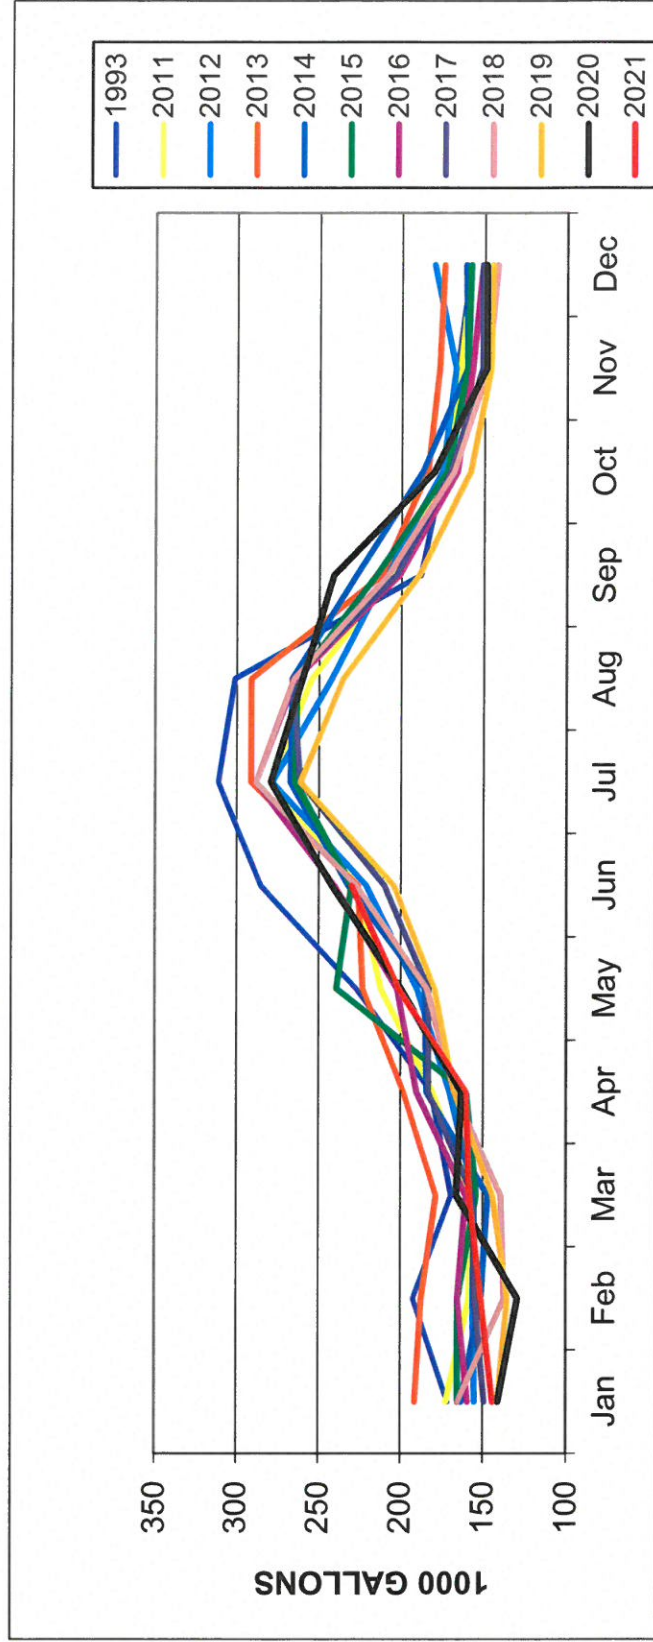

# Transfer Pumping NORTH POND WATER QUALITY



	1	2	3	4	5	6	7	8	9	10	11	12
2014	34	35	40	46	45	39	65	52	40	27	21	44
2015	59	54	40	44	36	33	50	47	36	23	24	32
2016	64	39	26	29	29	26	18	18	13	12	15	11
2017	23	26	23	23	31	27	39	25	24	21	32	31
2018	44	46	57	49	57	55	49	32	27	40	57	65
2019	65	48	25	22	44	47	45	37	27	21	24	31
2020	59	41	34	35	33	54	52	37	35	30	35	30
2021	48	32	28	45	47	51						





TOWN Of JAMESTOWN WWTF  
MONTHLY REPORT  
JUNE 2021

Douglas Ouellette, Superintendent

## **Parameters**

	<u>Monthly Avr.</u>	<u>Permit Limit</u>	<u>Notes</u>
Flow	.2087	MGD	.73 MGD
Daily Max	.3860		
BOD Removal	97.8%	85%	% Removed
TSS Removal	98.9%	85%	% Removed
Fecal Coliform	1.24	No limit, report only	
Enterococci	1.1	(<35 cfu/100ml Monthly)	(<276 cfu/100ml Daily)

## **Environmental Compliance (Violations)**

There are 0 violations to report for the month of June.

## **Complaints**

There were 2 complaints received for June. 9 Fowler Ave had slow flow, line was jetted and cleaned and improved the situation. 9 Coronado had a blocked service line the customer had to call a roofer service to clear the line.

## **Alarms**

The facility had two low Cl2 alarms for June.

## **Septage**

The facility received 3,250 gallons for June.

## **Sludge Production**

The facility processed 86,500 gallons of sludge through Wastewater Services Incorporated.

## **Maintenance Management**

Oils were changed in aerators#2 and 4,

## **Chemical Use**

The facility used 344 gallons of Sodium hypochlorite and 0 pounds of lime for process control.

## **Collection System**

30 pump station inspections were completed. All stations are operating as designed.

## **Energy Use**

Energy use for June 2021 was: 160 KWH

## **Precipitation**

Precipitation for June 2021 was 1.7”

## **Golf Course**

1.078 gallons of effluent was pumped to the pond in June.

## **Work Orders**

65 work orders were completed.

## Graphs

